



1811 4 Mile Road NE  
Grand Rapids, MI 49525  
phone 616.361.2664  
fax 616.361.1493  
progressiveae.com

## Submittal Transmittal

---

**Project:** W. Ludington Ave. Stearns Park Improvements Phase 1 **Date:** February 22, 2019

**File No:** 60096003

**Contractor**  
**Project No.:**

**To:** Tridonn Construction

**From:** Pam Young, Project Assistant

**Re:** Submittal

SPEC SECTION	DESCRIPTION	REVIEW CODE
	Anchors, Rings, Screws Addendum 2, AD-3, A1	No Exceptions Taken

**From:** Christopher J. Masacek PE, Lead Structural Engineer

---



Phone (231) 777-2681 Fax (231) 777-2506  
 1461 Evanston Avenue  
 Muskegon, Michigan 49442-5398

**SHOP DRAWING TRANSMITTAL FORM**

SHOP DRAWING NO: 3

SUBMIT TO: Progressive AE  
 1811 4 Mile Road NE  
 Grand Rapids, MI 49525  
 Craig Hondorp

DATE: February 1, 2019  
 RE: West Ludington Avenue Sterns Park  
 Improvements Phase 1

<u>QUANTITY</u>	<u>DRAWING NO.</u>	<u>DESCRIPTION</u>	<u>SPEC. NO.</u>	<u>CODE</u>
1ea	Submittal	Hilti SS HDI-5/8" Anchors, Nichel Plated 5/8" swivel hoist rings, 5/8" dia. x 7/8" set screws	Addendum 2, AD-3,A1	1

**CODES:** 1 – Conforms with Design Concept      3 – Not Acceptable  
 2 – Make Corrections As noted                      4 – Resubmit

**DISTRIBUTION REQUIEIMENTS:**

- (1) Tridonn Construction - Office Use
- (1) Tridonn Construction - Field Use
- (1) Progressive AE
- (1) Hilti

**TRIDONN CONSTRUCTION COMPANY**  
 BY: Brian K. Johnson

<b>TRIDONN CONST</b> 1461 Evanston Ave. Muskegon, MI	DATE <u>2.1.19</u> BY: <u>BKJ</u>
<input checked="" type="checkbox"/> CONFORMS WITH DESIGN CONCEPT <input type="checkbox"/> MAKE CORRECTIONS AS NOTED <input type="checkbox"/> NOT ACCEPTABLE <input type="checkbox"/> RESUBMIT	
THE ABOVE ACTION DOES NOT RELIEVE THE SUBCONTRACTOR OR SUPPLIER OF THEIR RESPONSIBILITY TO MEET REQUIREMENTS OF THE CONTRACT DOCUMENTS.	
Date Rec. <u>2.1.19</u> Date Sent to Arch. <u>2.1.19</u> Date Rec. from Arch. _____ Date Sent to Subcontractor _____	

## HDI, HDI-L, HDI+ and HDI-L+ Drop-in Anchor 3.3.11

### 3.3.11.1 Product description

HDI+, HDI-L+ and HDI drop-in anchors are internally threaded, flush mounted expansion anchors for use in concrete.

#### Product features

#### HDI+, HDI-L+ and HDI

- Anchor, setting tool and Hilti drill bit form a matched tolerance system to provide reliable fastenings
- Allows shallow embedment without sacrificing performance
- Lip allows accurate flush surface setting, independent of hole depth for the HDI-L+
- Ideal for repetitive fastenings with threaded rods of equal length
- HDI+ and HDI-L+ have an innovative stepped plug that reduces number of hammer blows by up to 50%

- HDI+ and HDI-L+ can be installed with the new HDI+ Setting Tool system (stop drill bit and machine setting tool) for improved productivity

#### Guide specifications

**Expansion anchor** shall be drop-in, shell or flush type. Carbon steel anchors are zinc plated in accordance with ASTM B633, SC 1, Type III. Stainless steel anchors are manufactured from AISI Type 303 stainless steel. Anchors shall be Hilti HDI+ (HDI-L+) (HDI) anchors as supplied by Hilti.

#### 3.3.11.1 Product description

#### 3.3.11.2 Material specifications

#### 3.3.11.3 Technical data

#### 3.3.11.4 Installation instructions

#### 3.3.11.5 Ordering information



### 3.3.11.2 Material specifications

HDI+, HDI-L+ and HDI anchors are manufactured from mild carbon steel. Anchor bodies are zinc plated in accordance with ASTM B633, SC 1, Type III.

HDI stainless steel anchors are manufactured from AISI Type 303 stainless steel.

### 3.3.11.3 Technical data

Table 1 - HDI+, HDI-L+ and HDI specifications<sup>1</sup>

Setting Information	Symbol	Units	HDI+ and HDI-L+			HDI	
			1/4	3/8	1/2	5/8	3/4
Insert thread	d	UNC	1/4-20	3/8-16	1/2-13	5/8-11	3/4-10
Nominal bit diameter	d <sub>bit</sub>	in.	3/8	1/2	5/8	27/32	1
Nominal embedment	h <sub>nom</sub>	in.	1	1-9/16	2	2-9/16	3-3/16
Anchor length	ℓ	(mm)	(25)	(40)	(51)	(65)	(81)
Hole depth	h <sub>o</sub>	(mm)					
Useable thread length	ℓ <sub>th</sub>	in.	7/16	5/8	11/16	7/8	1-3/8
		(mm)	(11)	(15)	(17)	(22)	(34)
Installation torque	T <sub>inst</sub>	ft-lb	4	11	22	37	80
		(Nm)	(5)	(15)	(30)	(50)	(109)
Minimum slab thickness	h	in.	3	3-1/8	4	5-1/8	6-3/8
		(mm)	(76)	(79)	(102)	(130)	(162)

<sup>1</sup> HDI+ and HDI-L+ are available in 1/4-, 3/8- and 1/2-in. The HDI is available in 5/8- and 3/4-in.

#### Combined shear and tension loading

$$\left(\frac{N_d}{N_{rec}}\right)^{5/3} + \left(\frac{V_d}{V_{rec}}\right)^{5/3} \leq 1.0$$

#### Listings/Approvals


##### FM (Factory Mutual)

Pipe Hanger Components for Automatic Sprinkler Systems HDI+ 3/8, HDI-L+ 3/8, HDI+1/2, HDI-L+ 1/2, HDI 5/8 and HDI 3/4

##### UL LLC

UL 203 Pipe Hanger Equipment for Fire Protection Services HDI+ 3/8, HDI-L+ 3/8, HDI+1/2, HDI-L+ 1/2, HDI 5/8 and HDI 3/4

3.3.11

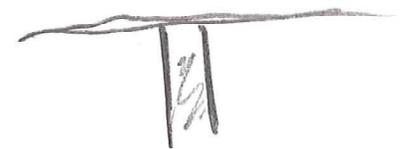

- NO EXCEPTIONS TAKEN
- MAKE CORRECTIONS NOTED
- REVISE & RESUBMIT
- REJECTED
- FOR RECORD PURPOSES ONLY

masacok / February 22, 2019

This submittal is reviewed for general conformance with the design concept of the project and with information given in the Contract Documents. This review shall not constitute approval of safety precautions and is not conducted for substantiating instructions for installation or performance of equipment or systems. This review does not relieve the contractor of responsibility for conformance with the Contract Documents and applicable codes, all of which have priority over this submittal. The Architect/Engineer does not warrant or represent that the information within the submittal is either accurate or complete. The contractor is responsible for coordinating and verifying all quantities, dimensions, tolerances, clearances, fabrication processes, techniques, sequences, means, methods of construction and compatibility of materials. It is also understood that the contractor has reviewed and coordinated all related trades and components of an assembly prior to issuing a submittal for review.

progressive|ae

### 3.3.11 HDI, HDI-L, HDI+ and HDI-L+ Drop-in Anchor

**Table 2 - HDI+, HDI-L+ and HDI carbon steel allowable loads in concrete (lb)<sup>1,2</sup>**

Nominal anchor diameter in.	$f'_c = 2,000$		$f'_c = 4,000$		$f'_c = 6,000$	
	Tension	Shear	Tension	Shear	Tension	Shear
1/4	500	450	570	625	790	700
3/8	635	965	920	1,250	1,260	1,500
1/2	945	1,500	1,605	1,940	1,950	2,500
5/8	1,875	2,500	2,920	3,250	3,715	3,750
3/4	2,500	3,875	4,065	5,000	5,565	5,500

**Table 3 - HDI+, HDI-L+ and HDI carbon steel ultimate loads in concrete (lb)<sup>1</sup>**

Nominal anchor diameter in.	$f'_c = 2,000$		$f'_c = 4,000$		$f'_c = 6,000$	
	Tension	Shear	Tension	Shear	Tension	Shear
1/4	1,995	1,800	2,270	2,500	3,150	2,800
3/8	2,540	3,850	3,685	5,000	5,035	6,000
1/2	3,780	6,000	6,425	8,500	7,810	10,000
5/8	7,500	1,000	11,685	13,000	14,865	15,000
3/4	10,000	15,500	16,260	20,000	22,250	22,000

- The shear tests were conducted with SAE Grade 5 bolts with minimum yield strength of 85 ksi and minimum tension strength of 120 ksi. Shear testing for the 1/4-in. models were conducted with SAE Grade 8 bolts with minimum yield strength of 120 ksi and minimum tension strength of 150 ksi in 6,000 psi concrete. High-strength bolts were used to force concrete failure modes. When using steel bolts with a lower tensile strength, steel failure must be considered.
- Allowable loads calculated with a factor of safety of 4.

**Table 4 - HDI+, HDI-L+ and HDI carbon steel allowable loads in lightweight concrete and lightweight concrete poured over metal deck (lb)<sup>1,2,3,4</sup>**

Nominal anchor diameter in.	Lightweight concrete		Lightweight concrete poured over metal deck			
			Upper flute		Lower flute	
	Tension	Shear	Tension	Shear	Tension	Shear
1/4	465	340	530	335	375	250
3/8	720	940	810	1,010	500	500
1/2	1,035	1,700	1,035	1,755	625	750
5/8	1,465	2,835			875	875
3/4	2,075	3,680			1,250	1,000

- The shear tests were conducted with SAE Grade 5 bolts with minimum yield strength of 85 ksi and minimum tension strength of 120 ksi. Shear testing for the 1/4-in. models were conducted with SAE Grade 8 bolts with minimum yield strength of 120 ksi and minimum tension strength of 150 ksi in 6,000 psi concrete. High-strength bolts were used to force concrete failure modes. When using steel bolts with a lower tensile strength, steel failure must be considered.
- Minimum compressive strength of structural lightweight concrete is 3,000 psi.
- See figure 1 for typical details.
- Allowable loads calculated with a factor of safety of 4.

**Table 5 - HDI stainless steel allowable loads in concrete (lb)<sup>1,2,3</sup>**


Nominal anchor diameter in.	$f'_c = 4,000$		$f'_c = 6,000$	
	Tension	Shear	Tension	Shear
1/4	480	600	740	600
3/8	1,040	1,230	1,460	1,230
1/2	1,840	2,760	2,410	2,760
5/8	2,630	4,510	3,770	4,510
3/4	3,830	5,580	5,030	5,580

**Table 6 - HDI stainless steel ultimate loads in concrete (lb)<sup>1,2</sup>**

Nominal anchor diameter in.	$f'_c = 4,000$		$f'_c = 6,000$	
	Tension	Shear	Tension	Shear
1/4	1,930	2,400	2,950	2,400
3/8	4,170	4,920	5,850	4,920
1/2	7,350	11,040	9,630	11,040
5/8	10,540	18,040	15,100	18,040
3/4	15,340	22,320	20,130	22,320

- Stainless steel models available in HDI version only.
- Shear testing conducted with 18-8 stainless steel bolts.
- Allowable loads calculated with a factor of safety of 4.

**Figure 1 - Installation of HDI drop-in anchor in the soffit of concrete over metal deck floor and roof assemblies W - deck**

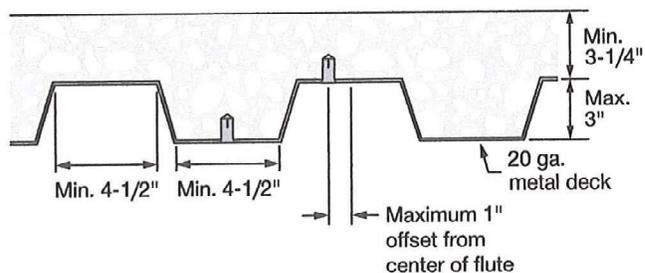

## HDI, HDI-L, HDI+ and HDI-L+ Drop-in Anchor 3.3.11


### Anchor spacing and edge distance guidelines

#### Anchor spacing adjustment factors

$s$  = Actual Spacing

$s_{min} = 2.0 h_{nom}$

$s_{cr} = 3.5 h_{nom}$


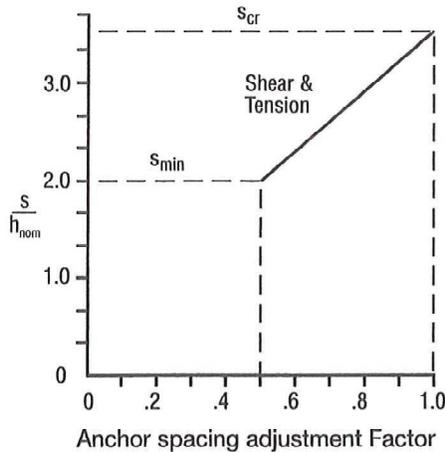


#### Edge distance adjustment factors

$c$  = Actual edge distance

$c_{min} = 2.0 h_{nom}$

$c_{cr} = 3.0 h_{nom}$

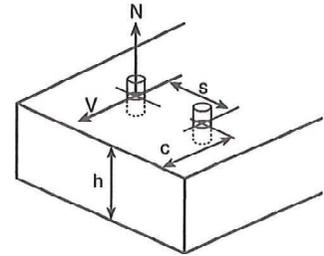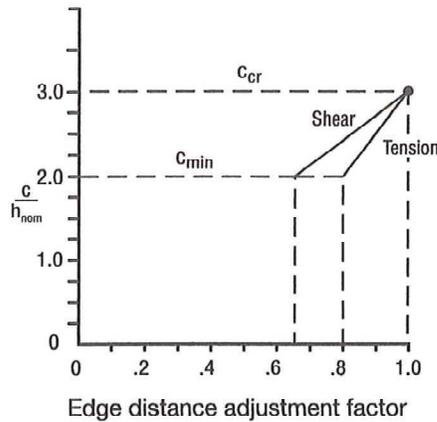

Influence of anchor spacing and edge distance  $f_A$  and  $f_R$

Anchor Size		$h_{nom}$	
in.	(mm)	in.	(mm)
1/4	(6.4)	1	(25)
3/8	(9.5)	1-9/16	(40)
1/2	(12.7)	2	(51)
5/8	(15.8)	2-9/16	(65)
3/4	(19.1)	3-3/16	(81)

$h_{nom}$  = nominal embedment depth

Table 7 - Load adjustment factors for HDI drop-in anchors in concrete

Load adjustment factors for anchor spacing $f_A$							Load adjustment factors for edge distance $f_R$											
Tension/shear loads							Tension $f_{RN}$					Shear $f_{RV}$						
Spacing $s$		Anchor diameter					Edge distance $c$		Anchor diameter					Anchor diameter				
in.	(mm)	1/4	3/8	1/2	5/8	3/4	in.	(mm)	1/4	3/8	1/2	5/8	3/4	1/4	3/8	1/2	5/8	3/4
2	(51)	.50					2	(51)	.80					.65				
2-1/2	(64)	.67					2-1/2	(64)	.90					.83				
3	(76)	.83	.50				3	(76)	1.0	.80				1.0	.65			
3-1/2	(89)	1.0	.58				3-1/2	(89)		.85					.73			
4	(102)		.69	.50			4	(102)		.91	.80				.85	.65		
4-1/2	(114)		.79	.58			4-1/2	(114)		.98	.85				.96	.74		
5	(127)		.90	.67	.50		5	(127)		1.0	.90	.80			1.0	.83	.65	
5-1/2	(140)		1.0	.75	.55		5-1/2	(140)			.95	.83				.91	.70	
6	(152)			.83	.61	.50	6	(152)			1.0	.87				1.0	.77	
7	(178)			1.0	.74	.57	6-1/2	(165)				.91	.80				.84	.65
8	(203)				.87	.67	7	(178)				.95	.84				.91	.72
9	(229)				1.0	.77	8	(203)				1.0	.90				1.0	.83
10	(254)					.88	9	(229)									.96	.94
11	(279)					.98	10	(254)										1.0
12	(305)					1.0												

$s_{min} = 2.0 h_{nom}$ $s_{cr} = 3.5 h_{nom}$ $f_A = 0.33 \frac{s}{h_{nom}} - 0.17$ for $s_{cr} > s > s_{min}$	$c_{min} = 2.0 h_{nom}$ $c_{cr} = 3.0 h_{nom}$ $f_{RN} = 0.2 \frac{c}{h_{nom}} + 0.4$ for $c_{cr} > c > c_{min}$	$c_{min} = 2.0 h_{nom}$ $c_{cr} = 3.0 h_{nom}$ $f_{RV} = 0.35 \frac{c}{h_{nom}} - 0.05$ for $c_{cr} > c > c_{min}$
-----------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------

3.3.11

### 3.3.11 HDI, HDI-L, HDI+ and HDI-L+ Drop-in Anchor

#### 3.3.11.4 Installation instructions

Manufacturer's Printed Installation Instructions (MPII) are included with each product package. They can also be viewed or downloaded at [www.us.hilti.com](http://www.us.hilti.com) (U.S.) and [www.hilti.ca](http://www.hilti.ca) (Canada). Because of the possibility of changes, always verify that downloaded MPII are current when used. Proper installation is critical to achieve full performance. Training is available on request. Contact Hilti Technical Services for applications and conditions not addressed in the MPII.

#### 3.3.11.5 Ordering information<sup>1</sup>

##### HDI+, HDI-L+ and HDI

###### Carbon steel

Description	Description	Anchor thread size	Qty / box
HDI+ 1/4	HDI-L+ 1/4	1/4	100
HDI+ 3/8	HDI-L+ 3/8	3/8	50
HDI+ 1/2	HDI-L+ 1/2	1/2	50
HDI 5/8	-	5/8	25
HDI 3/4	-	3/4	25

##### HDI-SS anchors

###### Stainless steel

Description	Anchor thread size	Qty / box
HDI 1/4 SS303	1/4	100
HDI 3/8 SS303	3/8	50
HDI 1/2 SS303	1/2	50
HDI 5/8 SS303	5/8	25
HDI 3/4 SS303	3/4	25

##### Setting tools for HDI and HDI-SS anchors

Description	Anchor thread size
HST 5/8 Setting Tool	5/8
HST 3/4 Setting Tool	3/4



##### Setting Tools for HDI+ and HDI-L+

Anchor thread size	Description
	HST 1/4 Setting tool
1/4	HSD-MM 1/4 (TE-C-24D6 1/4 Setting tool)
	HDI+ Setting Tool includes a TE-CX 3/8x1 carbide bit
	HST 3/8 Setting tool
3/8	HSD-MM 3/8 (TE-C-24SD10 3/8 Setting tool)
	HDI+ Setting Tool includes a TE-CX 1/2x1-9/16 carbide bit
	HST 1/2 Setting tool
1/2	HSD-MM 1/2 (TE-C-24SD12 1/2 Setting tool)
	HDI+ Setting Tool includes a TE-CX 5/8x2 carbide bit



<sup>1</sup> All dimensions in inches



**WESTECH RIGGING SUPPLY**  
*Outfitting The Pacific Northwest Since 1956*

What are you looking for? 

[Shop By Category > Rigging Hardware > Hoist Rings](#)

[Shop By Brand > American Drill Bushing > ADB En-Guard Nickel Plated Swivel Hoist Rings](#)

**ADB 5/8"-11 x 1" En-Guard Nickel Plated Swivel Hoist Ring - 4000 lbs WLL - #EN33614**



Image shown may be a stock photo and is for reference only.



**SKU: ADB-EN33614    MPN: EN33614**

**Be the first to write a review!**

 **Ask a Question**





## 18-8 Stainless Steel Cup-Point Set Screws



Made from 18-8 stainless steel, these set screws are chemical resistant and may be mildly magnetic. They have a thin edge that digs into the contact surface for a secure hold. Length listed is the overall length.

 For technical drawings and 3-D models, click on a part number.

Lg.	Drive Size	Hardness	Specifications Met	Pkg. Qty.	Pkg.
<b>18-8 Stainless Steel</b>					
<b>5/8"-11</b>					
7/8"	5/16"	Rockwell B80	ASME B18.3	5	<b>92311A351</b> \$6.37

[Product Detail](#) 

18-8 Stainless Steel Cup-Point Set Screw,  
5/8"-11 Thread, 7/8" Long

Packs of 5

In stock

*9 Packs*